



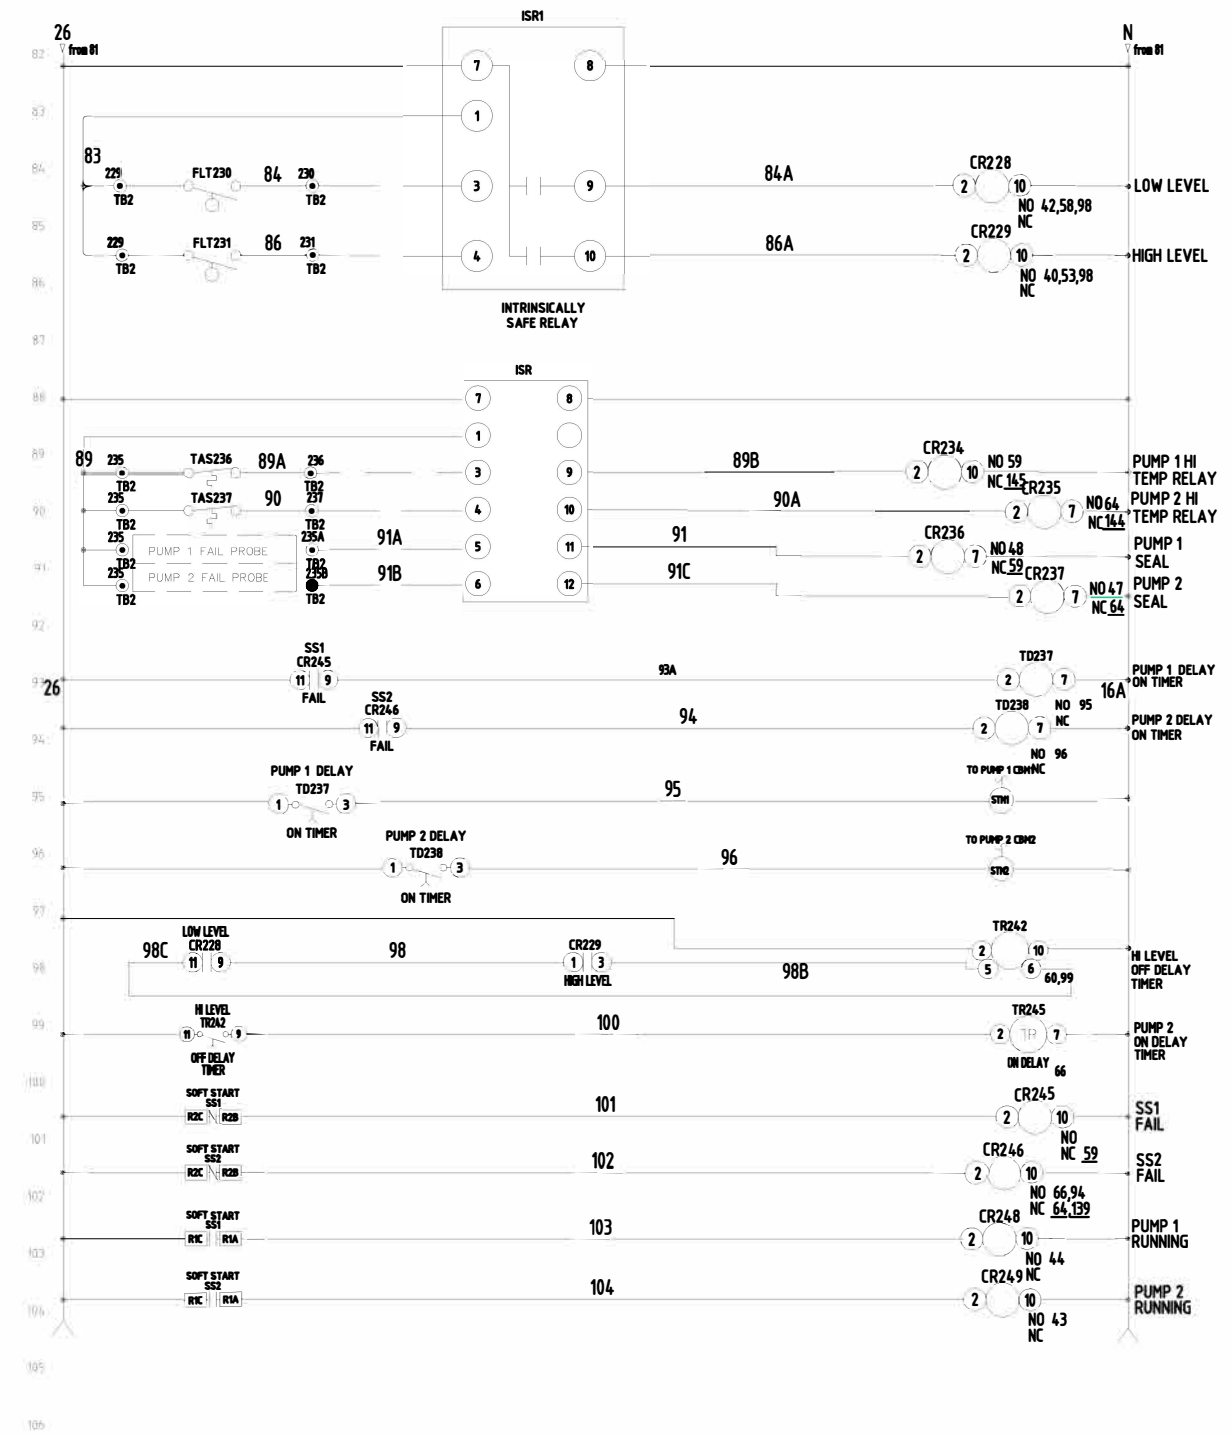

DRAWN: KHA

ELECTRICAL SCHEMATIC 2 (FOR 230 OR 480V)*

E-5

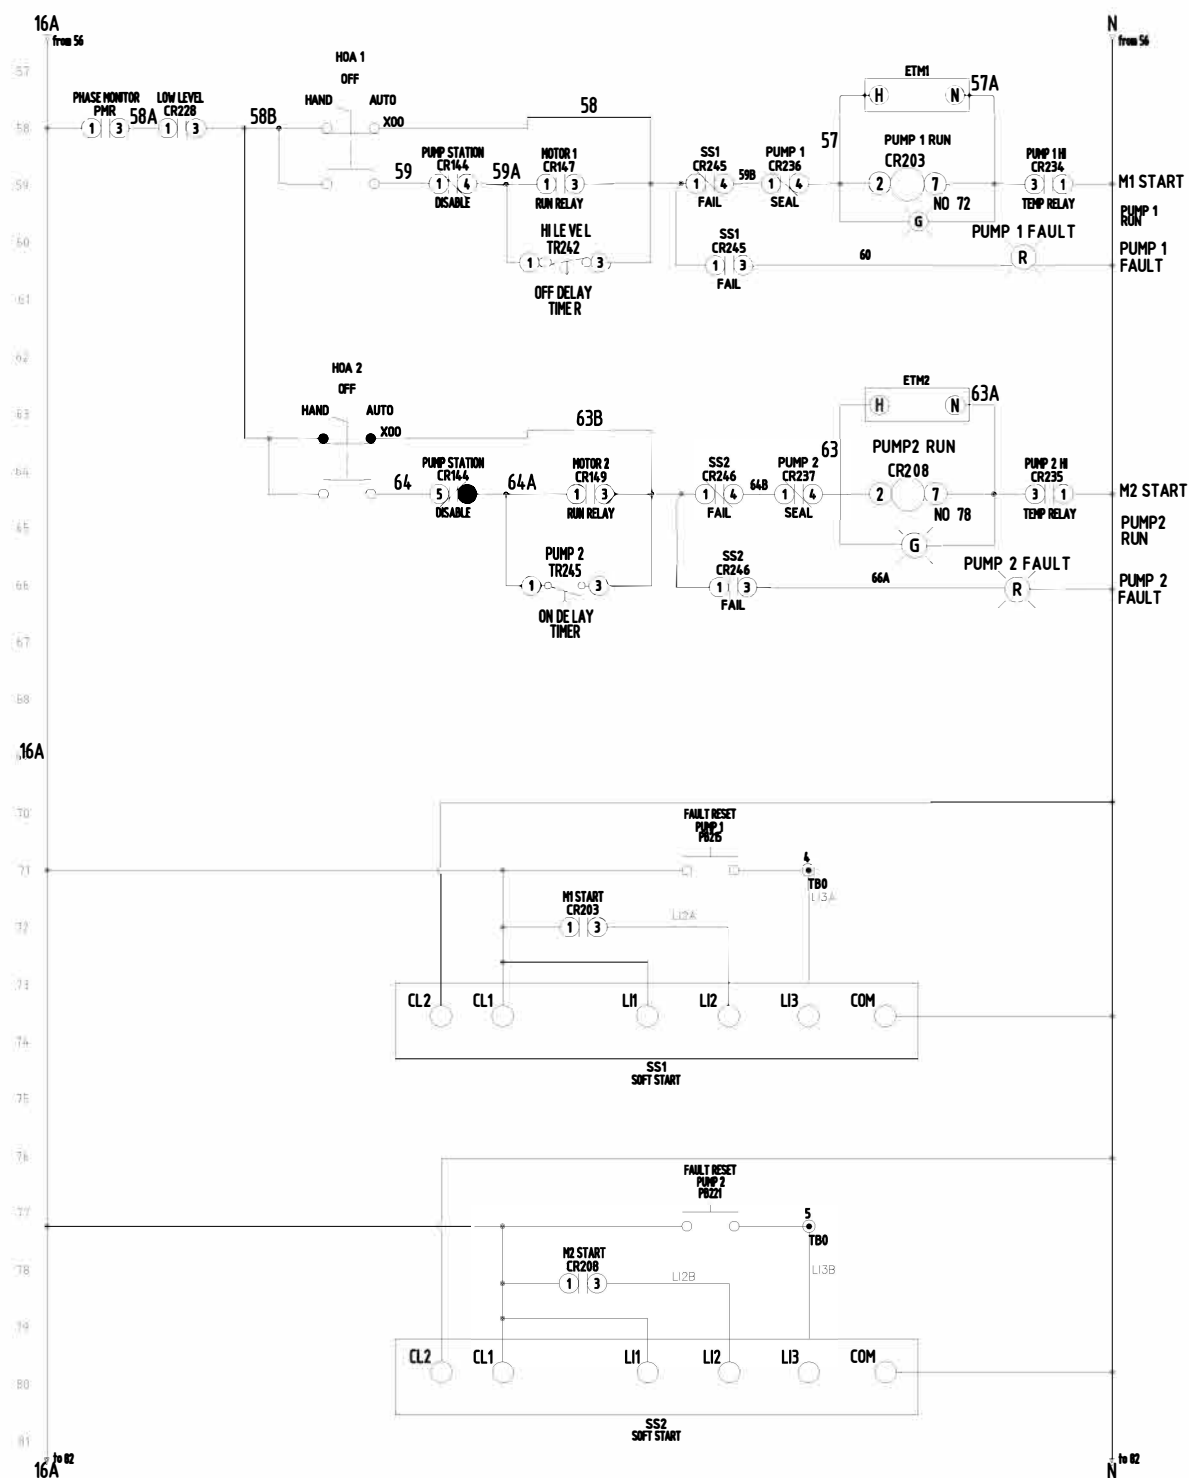

FIELD WIRING TERMINALS USE
COPPER, 75°C MINIMUM WIRE
TORQUE ALL FIELD WIRING
TERMINALS TO 18-20 IN-LBS.