

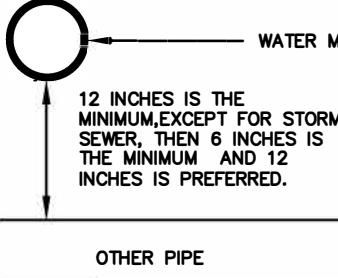
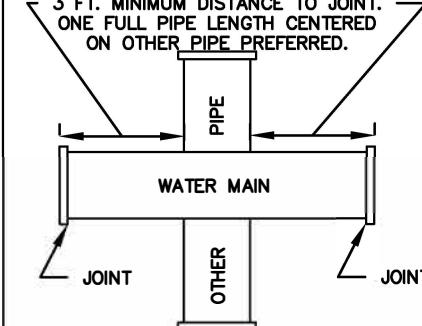

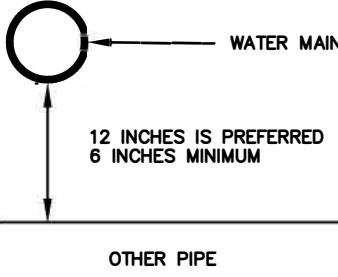
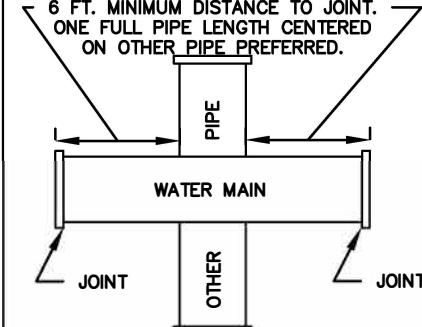

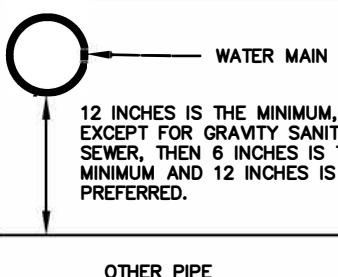


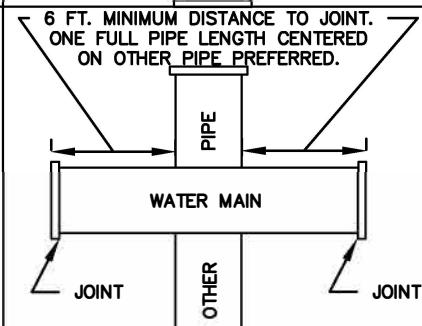

DATE: 08/24

DRAWN: KHA

OTHER PIPE	HORIZONTAL SEPARATION	VERTICAL SEPARATION (SEE 1) (PROFILE VIEW)	VERTICAL SEPARATION (PLAN VIEW)
STORM SEWER, STORMWATER FORCEMAIN, RECLAIMED WATER (SEE 2)	 <p>WATER MAIN 3 FT. MINIMUM OTHER PIPE</p>	 <p>WATER MAIN 12 INCHES IS THE MINIMUM, EXCEPT FOR STORM SEWER, THEN 6 INCHES IS THE MINIMUM AND 12 INCHES IS PREFERRED. OTHER PIPE</p>	 <p>WATER MAIN 3 FT. MINIMUM DISTANCE TO JOINT. ONE FULL PIPE LENGTH CENTERED ON OTHER PIPE PREFERRED. PIPE JOINT OTHER JOINT</p>
VACUUM SANITARY SEWER	 <p>WATER MAIN 10 FT. PREFERRED 3 FT. MINIMUM OTHER PIPE</p>	 <p>WATER MAIN 12 INCHES IS PREFERRED 6 INCHES MINIMUM OTHER PIPE</p>	 <p>WATER MAIN 6 FT. MINIMUM DISTANCE TO JOINT. ONE FULL PIPE LENGTH CENTERED ON OTHER PIPE PREFERRED. PIPE JOINT OTHER JOINT</p>
GRAVITY SANITARY SEWER (SEE 3), WASTEWATER FORCEMAIN, RECLAIMED WATER (SEE 4)	 <p>WATER MAIN 10 FT. PREFERRED 6 FT. MINIMUM (SEE 3) OTHER PIPE</p>	 <p>WATER MAIN 12 INCHES IS THE MINIMUM, EXCEPT FOR GRAVITY SANITARY SEWER, THEN 6 INCHES IS THE MINIMUM AND 12 INCHES IS PREFERRED. OTHER PIPE</p>	 <p>WATER MAIN 6 FT. MINIMUM DISTANCE TO JOINT. ONE FULL PIPE LENGTH CENTERED ON OTHER PIPE PREFERRED. PIPE JOINT OTHER JOINT</p>
ON-SITE SEWAGE TREATMENT AND DISPOSAL SYSTEM	10 FT. MINIMUM		

NOTES:

1. WATER MAIN SHOULD CROSS ABOVE THE OTHER PIPE. WHEN WATER MAIN MUST BE BELOW OTHER PIPE, THE MINIMUM SEPARATION IS 12 IN.
2. RECLAIMED WATER REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C.
3. 3 FEET FOR GRAVITY SANITARY SEWER WHERE THE BOTTOM OF THE WATER MAIN IS LAID AT LEAST 6 INCHES ABOVE THE TOP OF THE GRAVITY SANITARY SEWER.
4. ADDITIONAL REQUIREMENTS MAY APPLY, REFER TO F.A.C. RULE 62-555.314.