


TYPICAL FAN GUARD

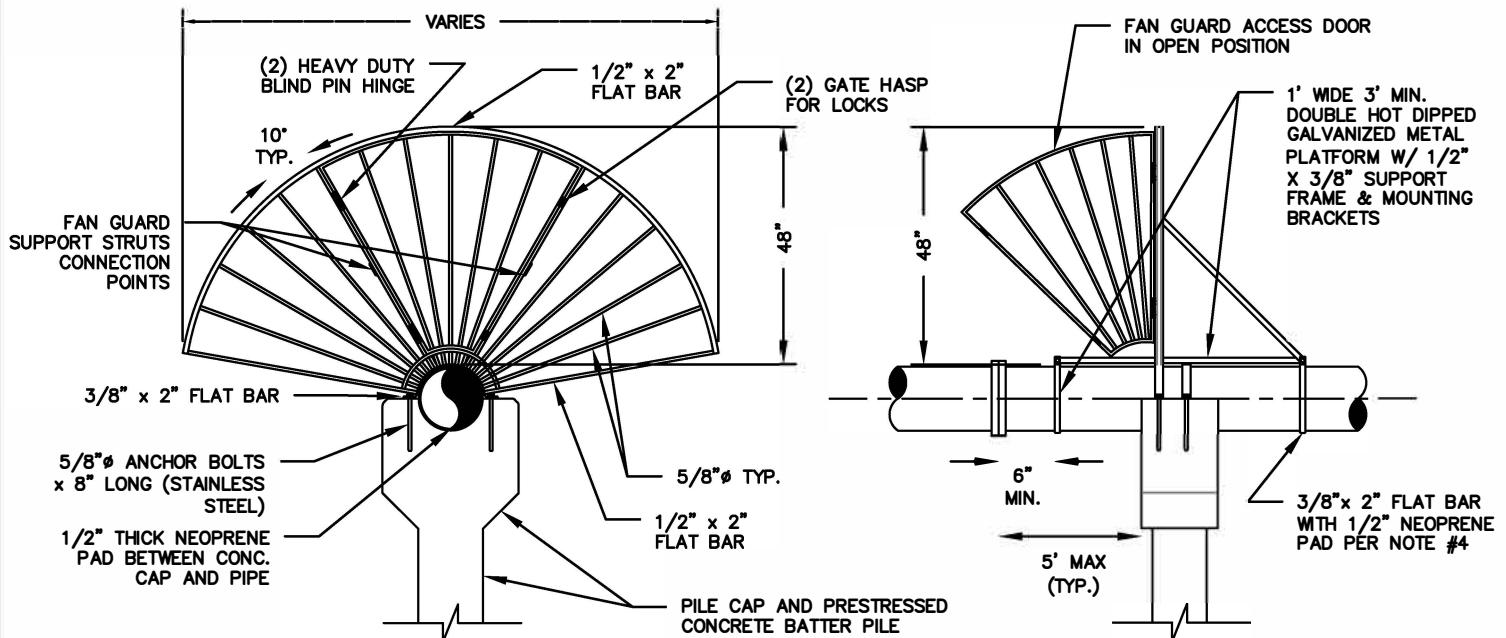

NOTES:

1. FAN GUARD SHALL BE PLACED AT EACH END OF CANAL CROSSING.
2. ANCHOR BOLTS AND MISCELLANEOUS HARDWARE, NUTS, BOLTS, SHALL BE STAINLESS STEEL.
3. FAN GUARD AND ALL MOUNTING BRACKETS TO BE HOT DIP GALVANIZED AND MOUNTING HARDWARE TO BE STAINLESS STEEL.
4. 1/2" THICK NEOPRENE PAD TO INSULATE PIPE FROM CONTACT WITH ALL MOUNTING HARDWARE, FAN GUARD HARDWARE, AND CONCRETE SURFACES.

FAN GUARD WITH ARV ACCESS
(SWINGS OUTWARD)

DATE: 08/24

DRAWN: KHA



CITY OF MARGATE, FLORIDA
DEPARTMENT OF ENVIRONMENTAL
AND ENGINEERING SERVICES

TYPICAL FAN GUARD

G-22